



Town of Florence
Public Works Department
444 N. Warner Street
Florence, AZ 85132
(520) 868-7614
www.florenceaz.gov

**Solicitation WU-23 – Well #2B Outfitting
ADDENDUM #2
Questions and Answers
October 11, 2018**

QUESTION: Chemical cleaning well and brushing?

ANSWER: Brush, video, test pump. Do not worry about chemical cleaning.

QUESTION: Do we include pricing on this without a video first?

ANSWER: Include price for brush / video.

QUESTION: Can I have the old test pump data?

ANSWER: Yes, they are attached to this Addendum.

QUESTION: As built drawing on the well shows Bentonite Seal @ 280-300' and Tacna Filter Pack already in place. Is the 1 ½ sounding tube already in place?


ANSWER: No.

QUESTION: The estimated pump setting is 460' plus bowl and head joint (estimated 480' total. This puts the bowl assembly in the louvered screen area. Is it preferred to have the bowl in a blank casing zone?

ANSWER: We want the pump in blank casing zone – 380'.

QUESTION: I need the concrete base size and construction.

ANSWER: 10' x 10' x 10" thick w/ 1 foot around case 5' deep.

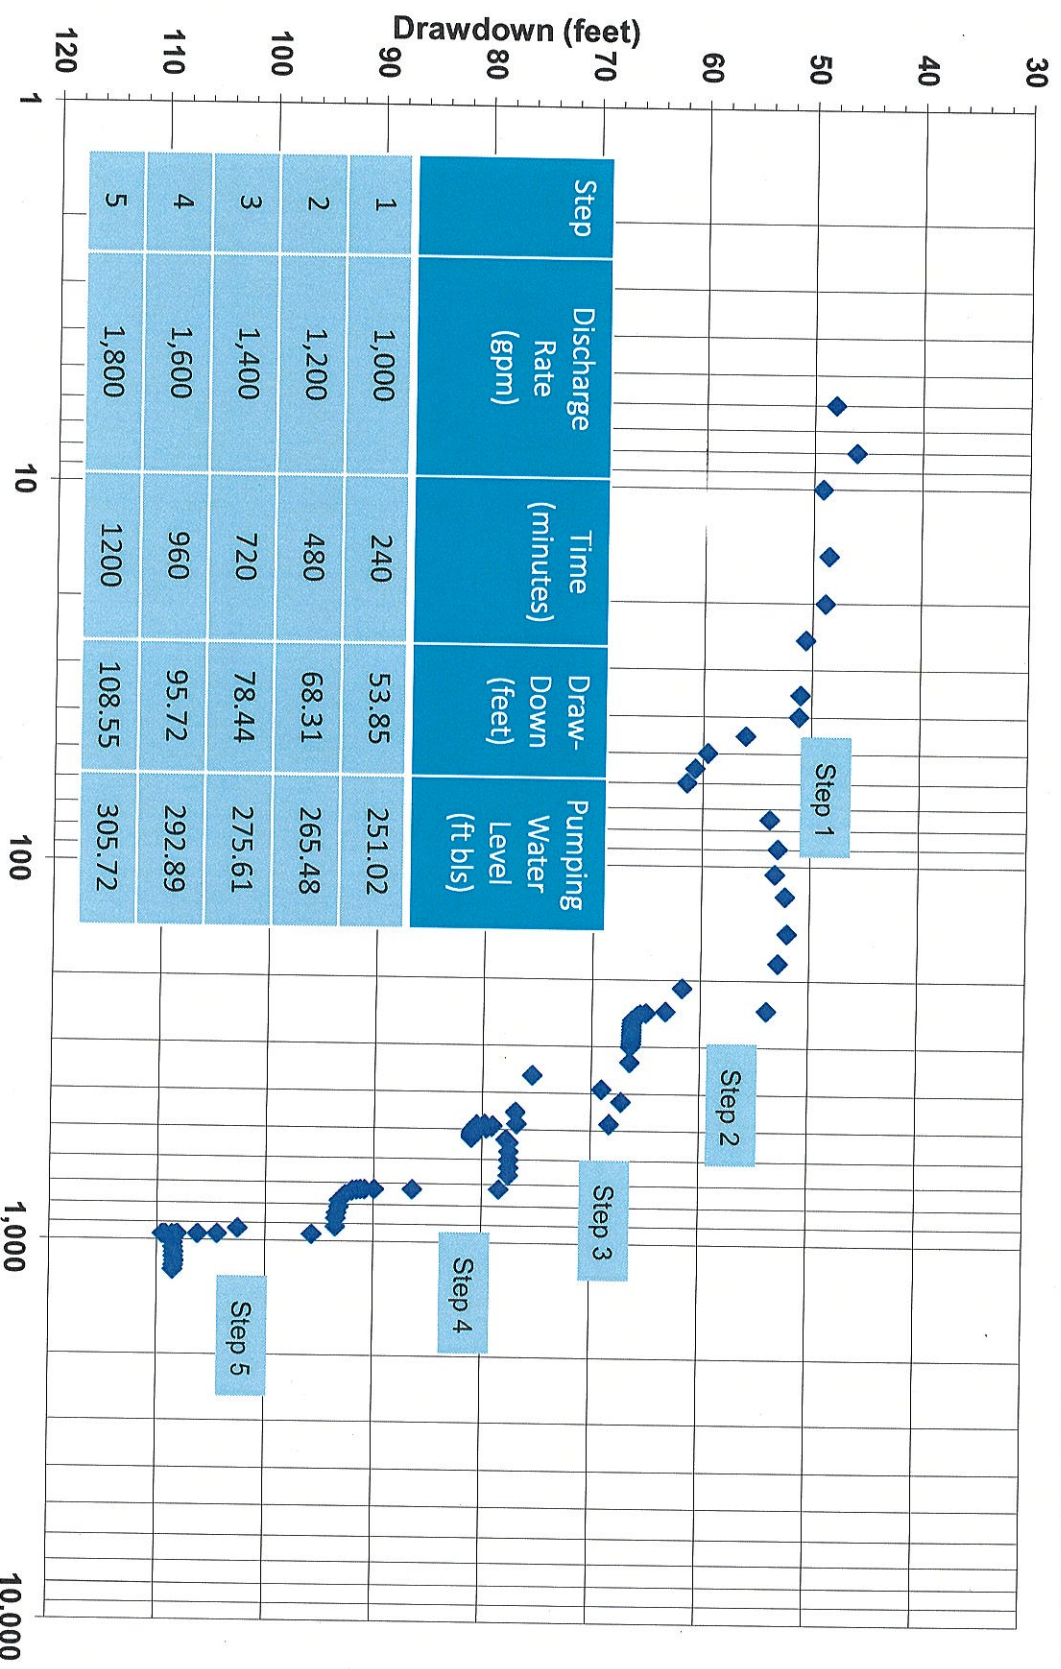


Southwest Ground-water
Consultants, Inc.

August 14, 2015 Project B-2068

STEP-RATE TEST, JUNE 24-25, 2015
DRAWDOWN VS. TIME
Town of Florence Well #2
Pinal County, Arizona

Figure

5

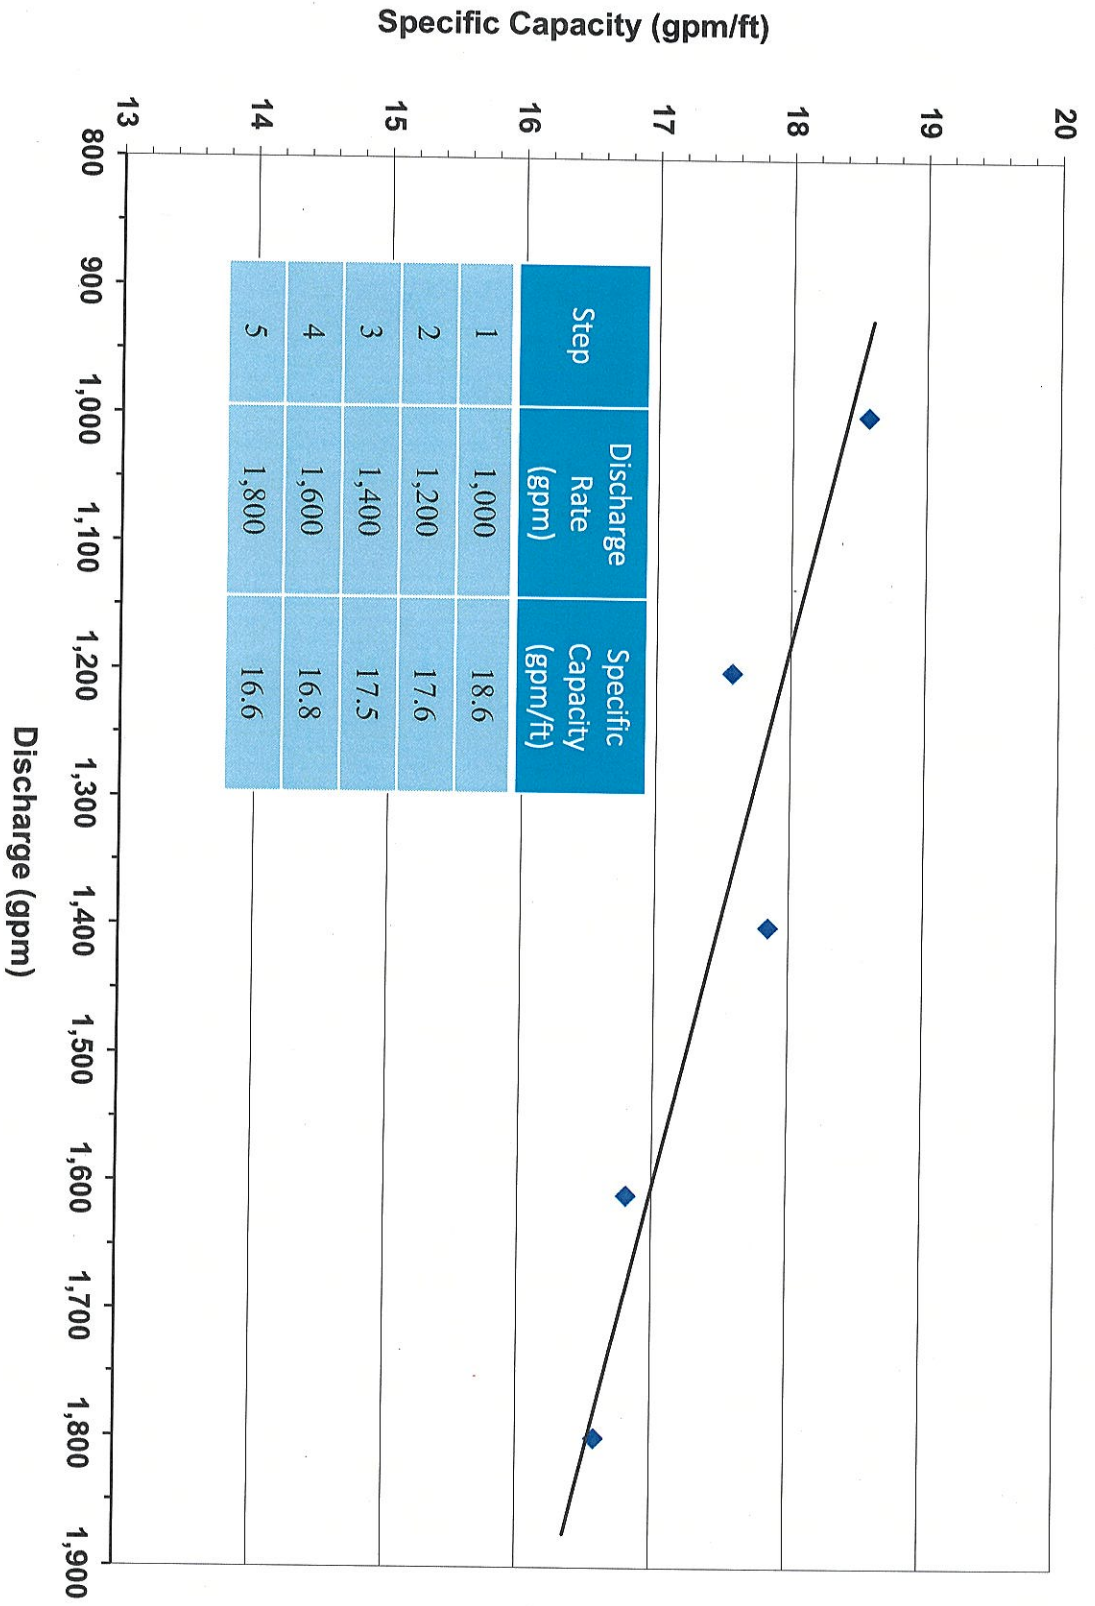


Southwest Ground-water
Consultants, Inc.

August 14, 2015 Project B-2068

STEP-RATE TEST, JUNE 24-25, 2015
SPECIFIC CAPACITY VS. DISCHARGE
Town of Florence Well #2
Pinal County, Arizona

Figure

6

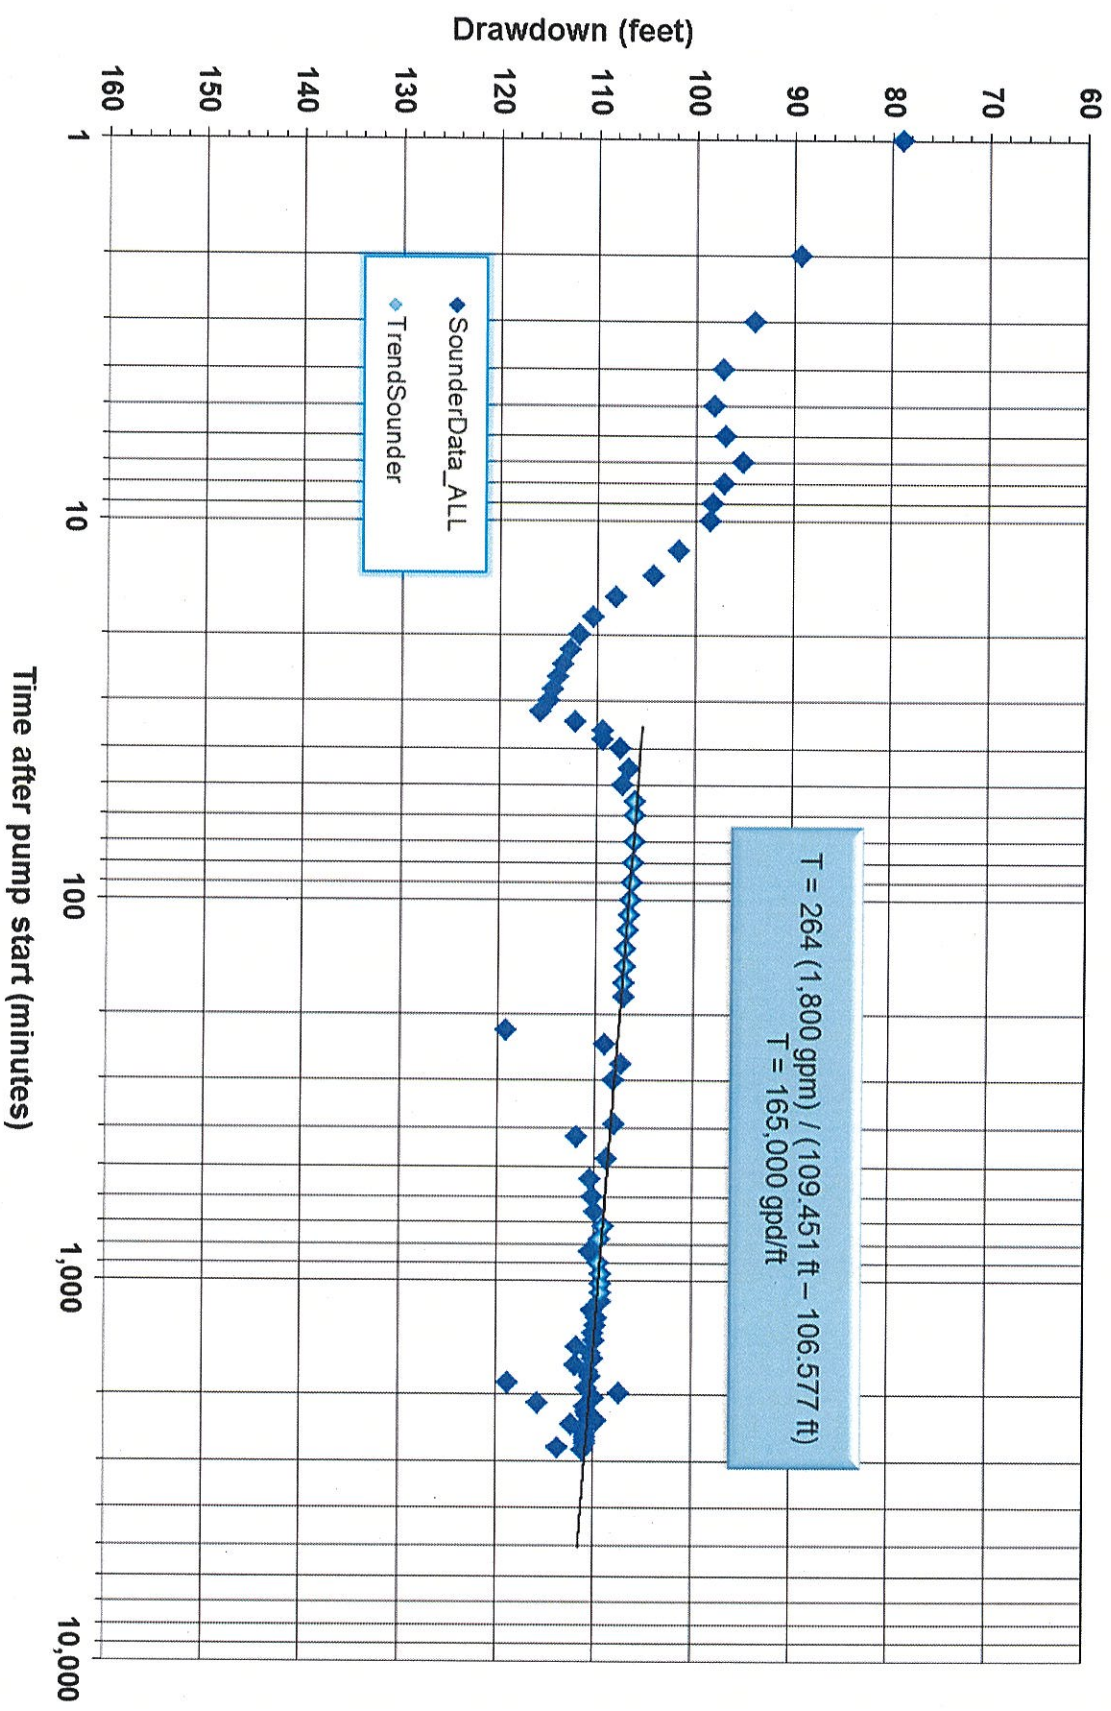


Southwest Ground-water
Consultants, Inc.

August 14, 2015 Project B.2068

CONSTANT-RATE TEST, JUNE 26-28, 2015
DRAWDOWN VS. TIME
Town of Florence Well #2
 Pinal County, Arizona

Figure
7

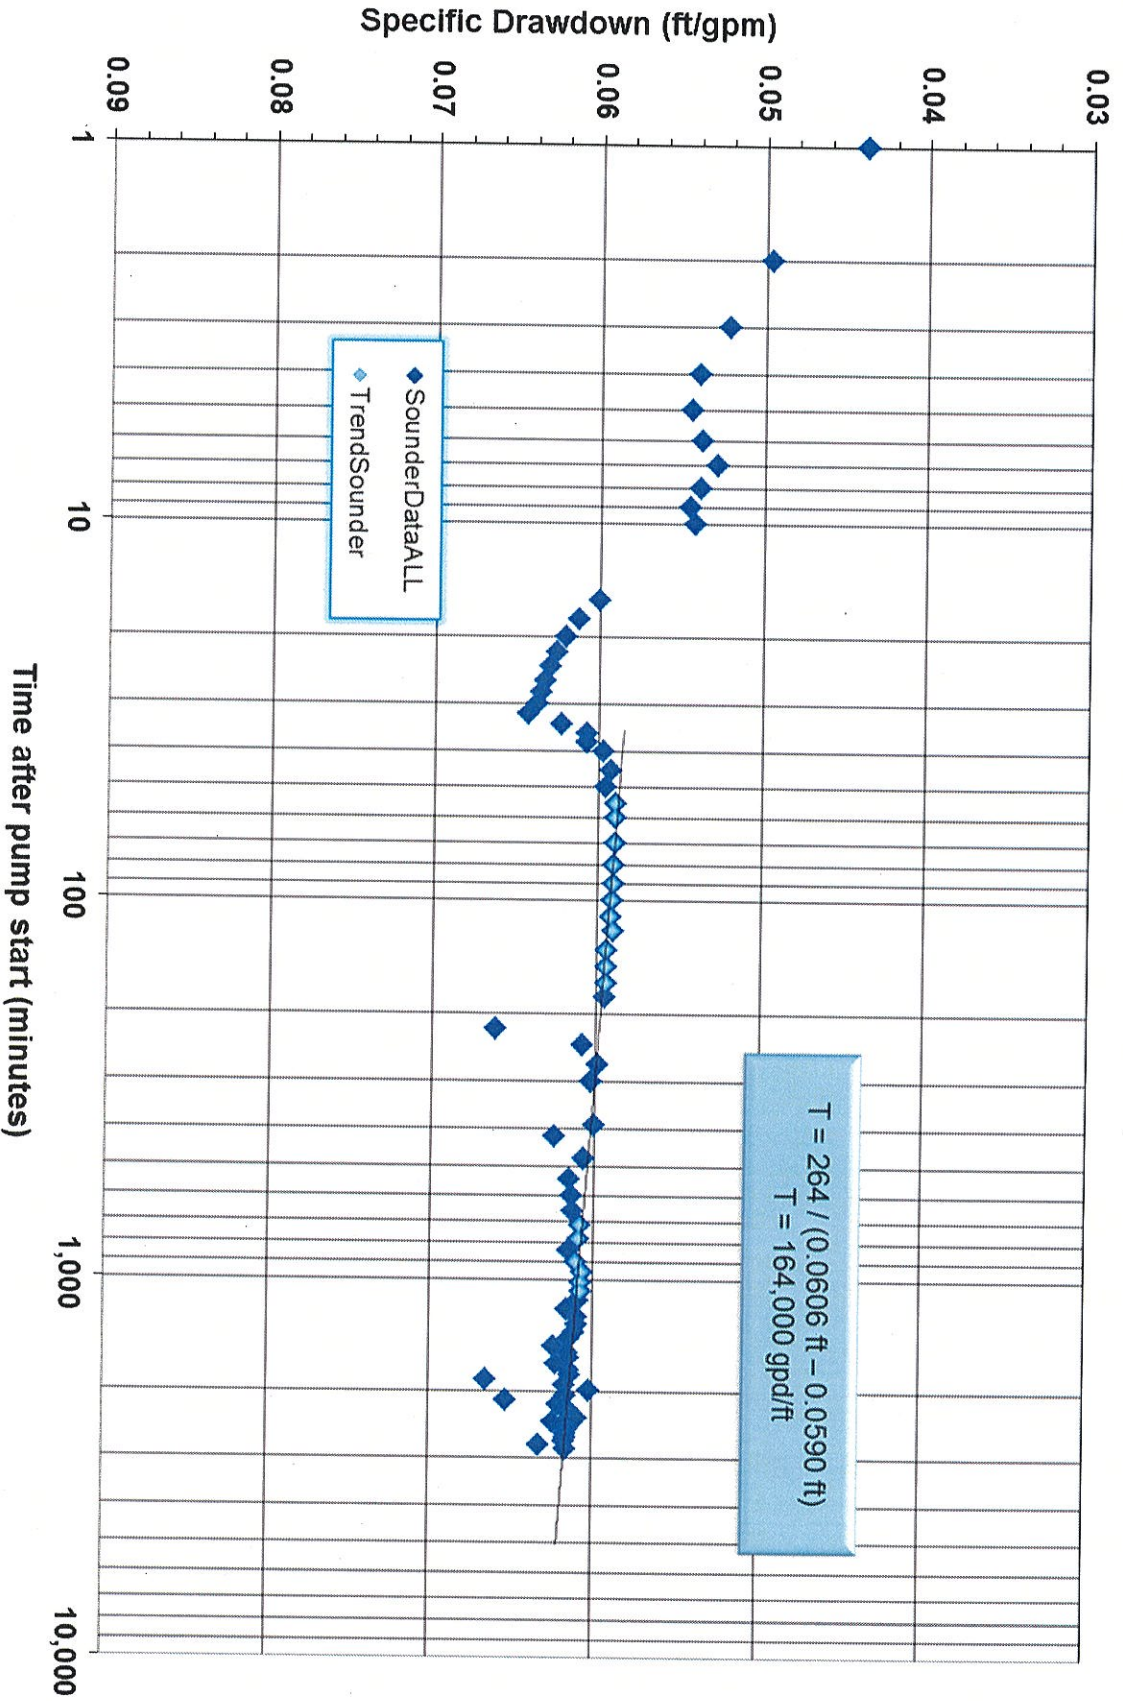


Southwest Ground-water
Consultants, Inc.

August 14, 2015 Project B.2068

CONSTANT-RATE TEST, JUNE 26-28, 2015
SPECIFIC DRAWDOWN VS. TIME
Town of Florence Well #2
Pinal County, Arizona

Figure

8

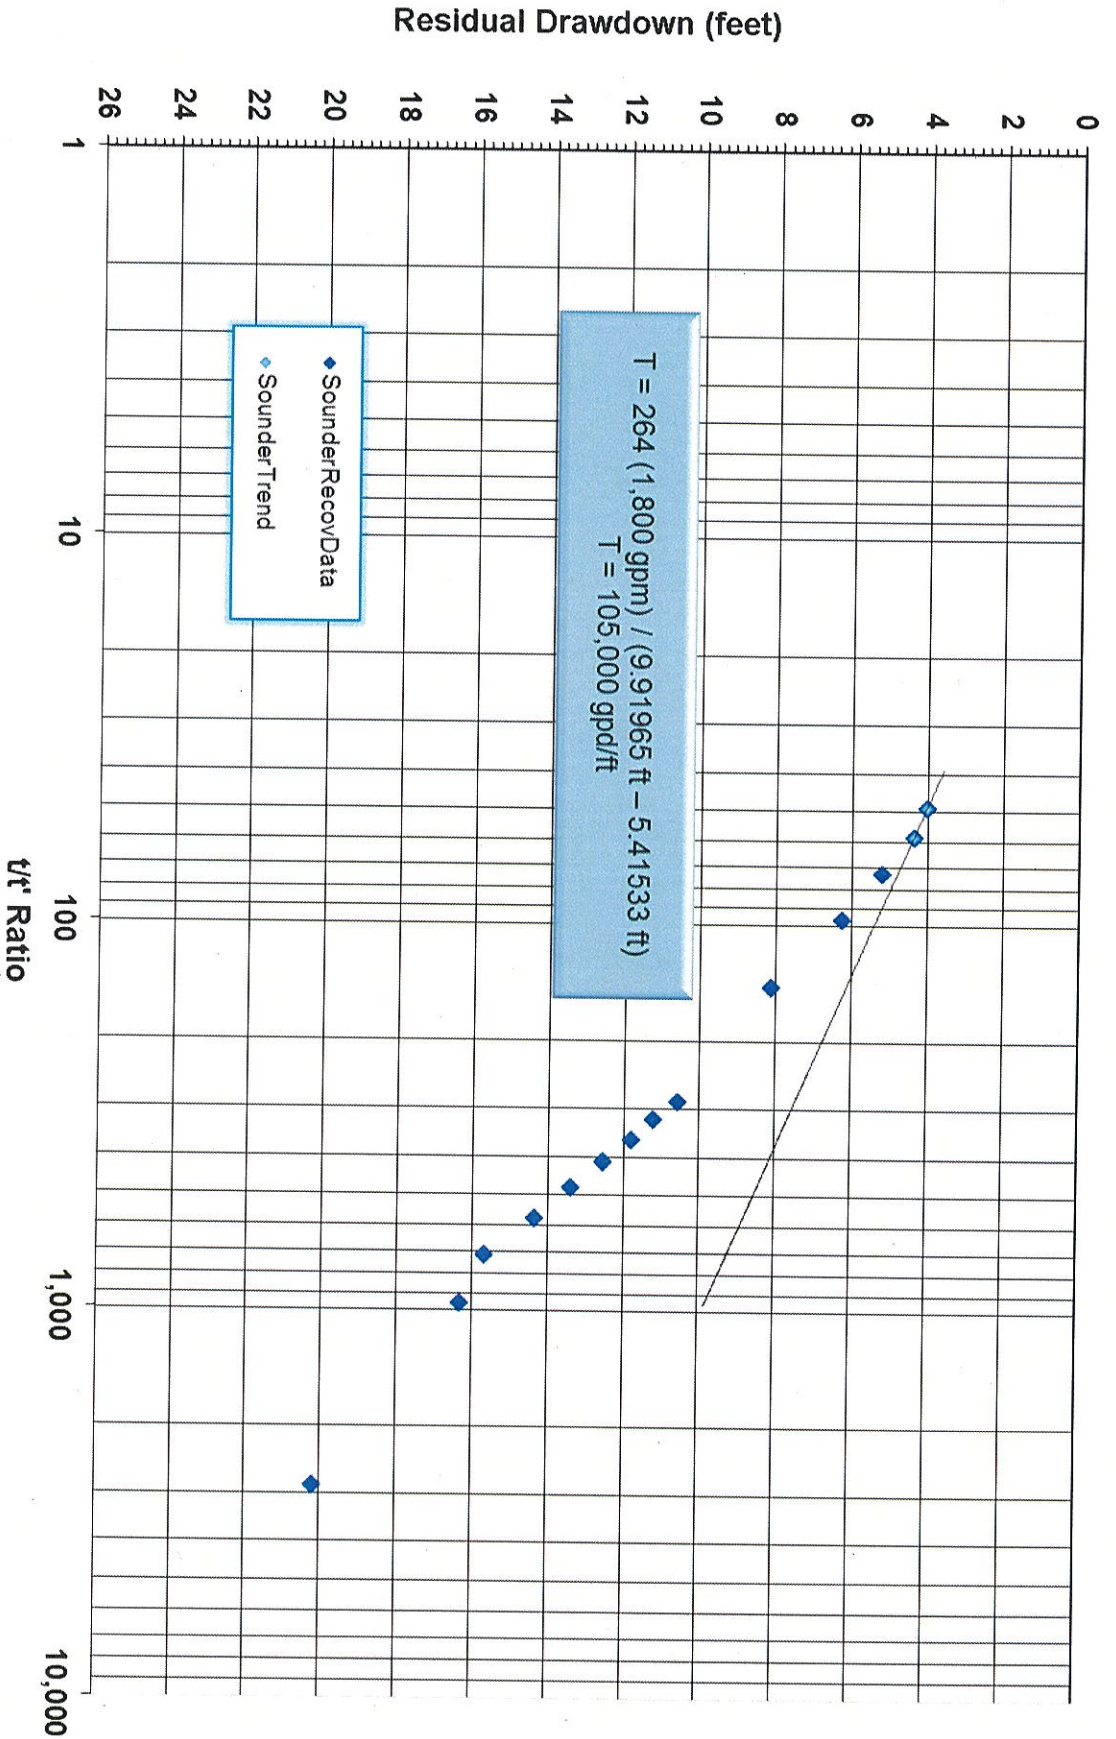


Southwest Ground-water
 Consultants, Inc.

August 14, 2015 Project B-2068

CONSTANT-RATE RECOVERY TEST, JUNE 28, 2015
RESIDUAL DRAWDOWN VS. T/T' RATIO
Town of Florence Well #2
 Pinal County, Arizona

Figure

9

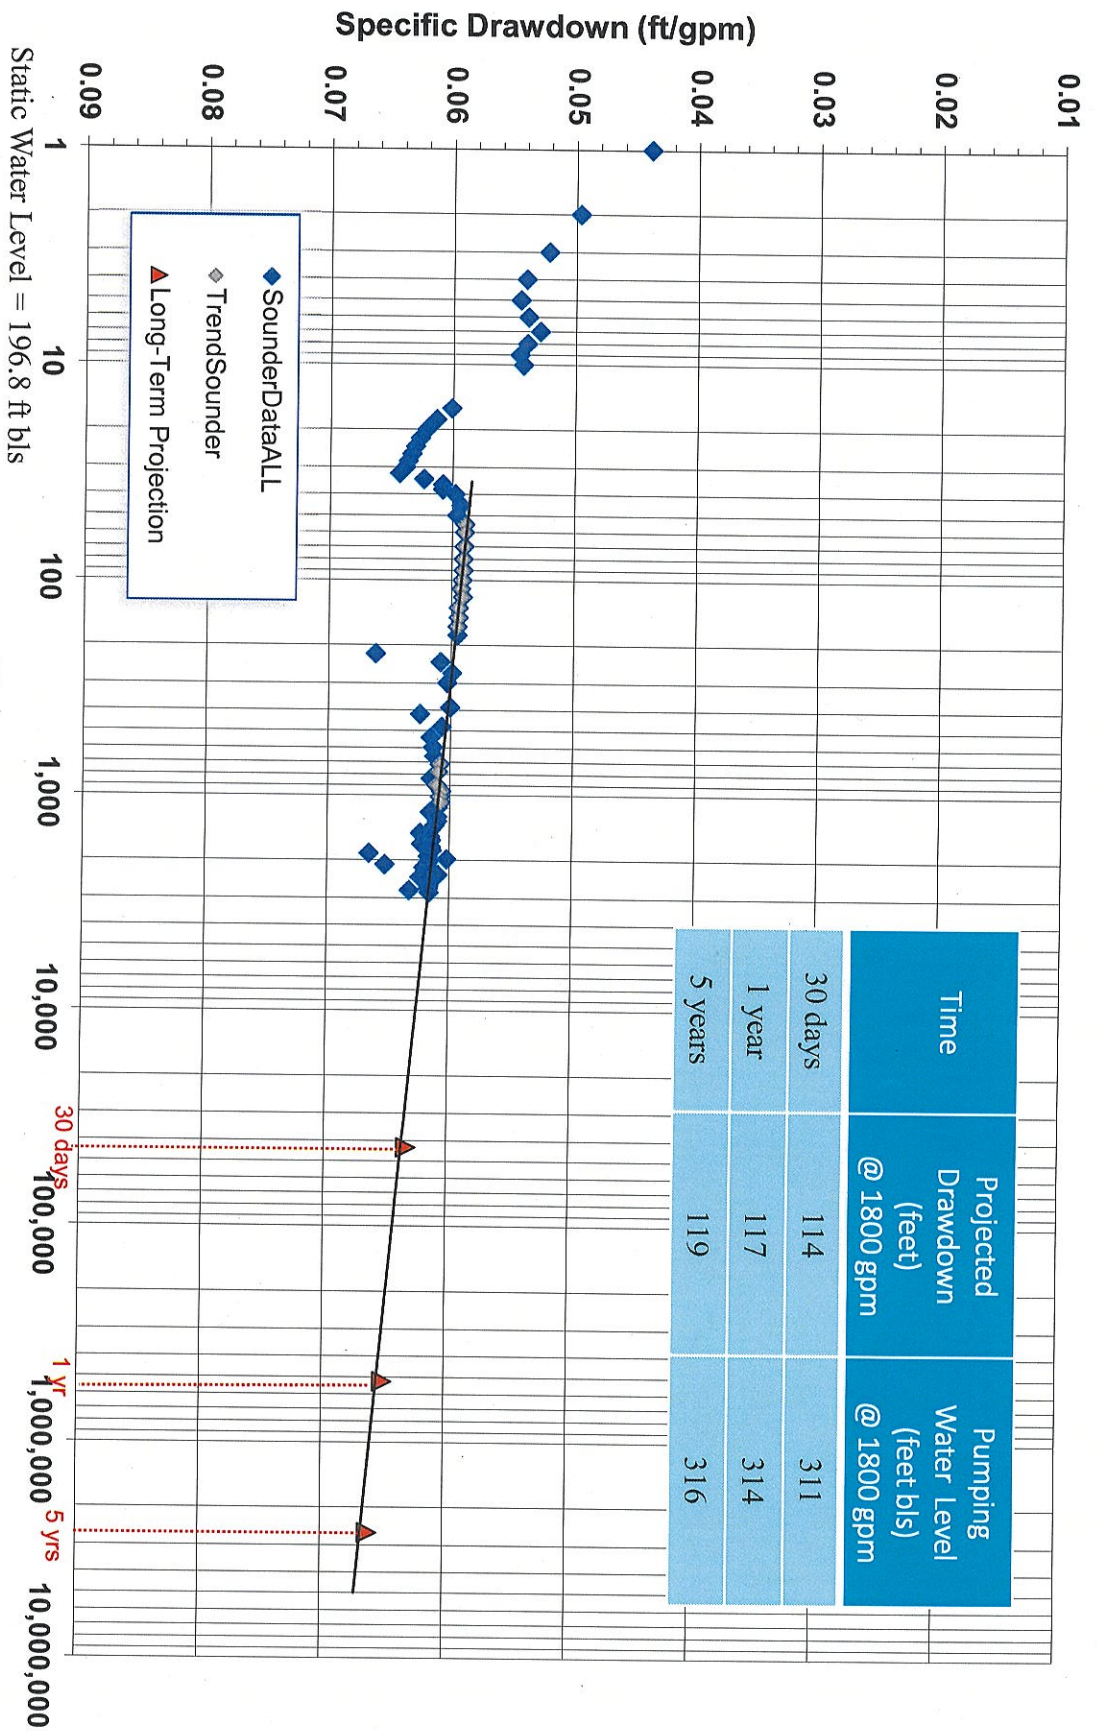

Southwest Ground-water
Consultants, Inc.

August 14, 2015 Project B.2068

**PROJECTED PUMPING WATER LEVELS
BASED ON CONSTANT RATE TEST, JUNE 26-28, 2015**

Town of Florence Well #2
Pinal County, Arizona

Figure

10